


$x \leq 36$  in. (914 mm)  
 $s$  = Maximum allowable distance  
 between sprinklers

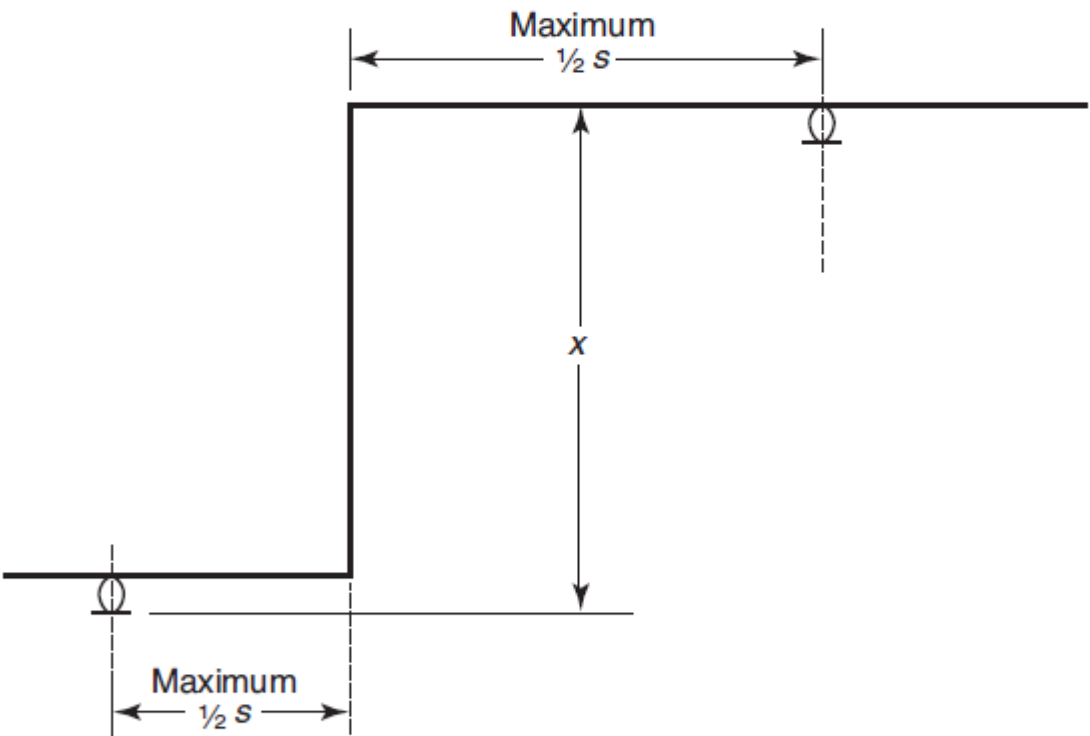

← Vertical plane treated as wall  
 for sprinkler spacing

$x > 36$  in. (914 mm)  
 $s$  = Maximum allowable distance  
 between sprinklers

**FIGURE 8.6.4.1.1.3 Vertical Changes in Ceiling Elevations.**